


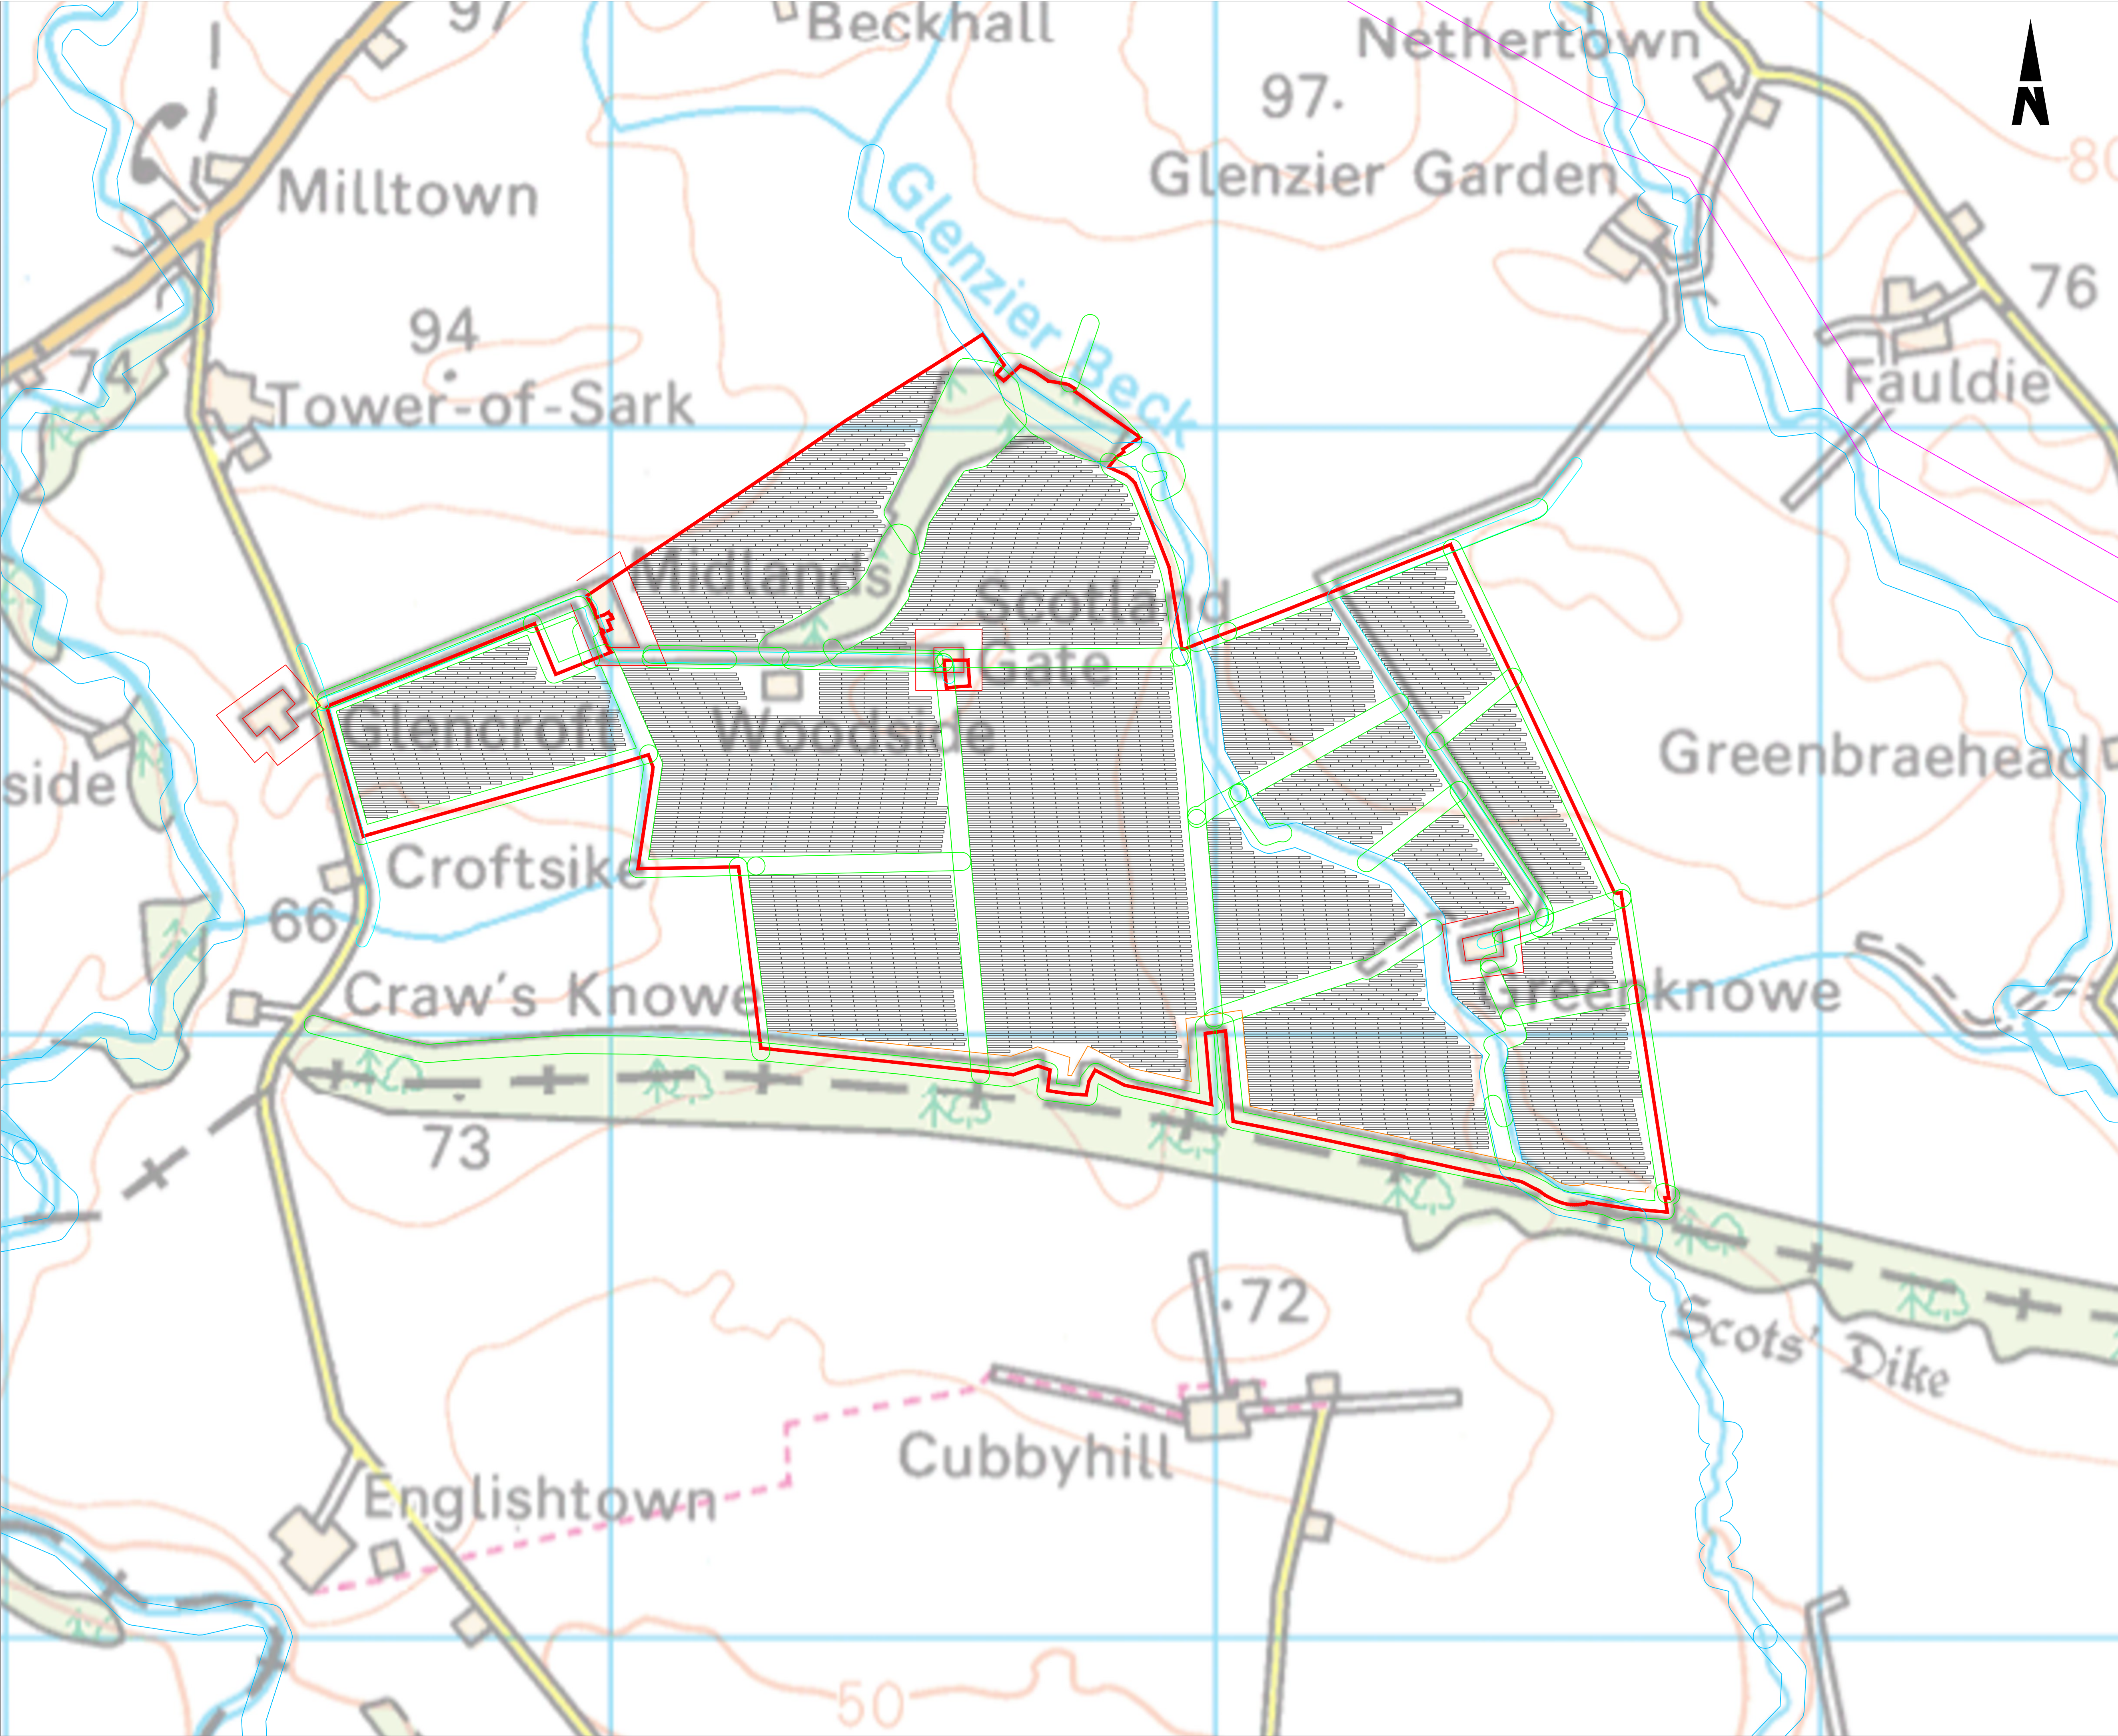

NOTES

1. Verifying Dimensions.
The contractor shall verify dimensions against such other drawings or site conditions as pertain to this part of the work.

2. Existing Services.
Any information concerning the location of existing services indicated on this drawing is intended for general guidance only. It shall be the responsibility of the contractor to determine and verify the exact horizontal and vertical alignment of all cables, pipes, etc. (both underground and overhead) before work commences.

3. Issue of Drawings.
Hard copies, dwf and pdf will form a controlled issue of the drawing. All other formats (dvg, dxf etc.) are deemed to be an uncontrolled issue and any work carried out based on these files is at the recipients own risk. RPS will not accept any responsibility for any errors arising from the use of these files, either by human error by the recipient, listing of un-dimensioned measurements, compatibility issues with the recipient's software, and any errors arising when these files are used to aid the recipients drawing production, or setting out on site.

Legend

Site Location Boundary

30m Buffer to Residential Properties
(Indicative property location and associated buffer extratived from OS Base only)

30m Buffer to Scots Dike plantation

20m Buffer to High Pressure Gas Pipeline Network

5m Buffer to Overhead Lines

15m Buffer to Woodland Areas, Trees and Hedgerows

20m Buffer to Watercourses

10m Buffer to Existing Laneway Access

Indicative Solar Array Locations

Rev	Description	Date	Dm / Chk / App		
TETRA TECH Issuing Office: Elmwood House, 74 Boucher Road Belfast, BT12 6RZ Tel: +44 (0) 28 9066 7914 tetratech.com/europe					
Client BUCCLEUCH					
Project Name Hall Burn Renewable Energy Scheme					
Sheet Title Indicative Panel Layout (Southern Array)					
Model Reference -					
TTE Project Number 794-NI-P&E-02777		Drawn By SA	Checked By -	Approved By -	Scale @ A1
Document Reference 02777-TTE-ZZ-XX-DR-LA-0005		Project Number - Originator - Function - Spatial - Type - Role - Number 794-NI-P&E-02777	Revision -	Status Draft	
© Copyright Tetra Tech Consulting Limited TTE_A1_V1.1					