


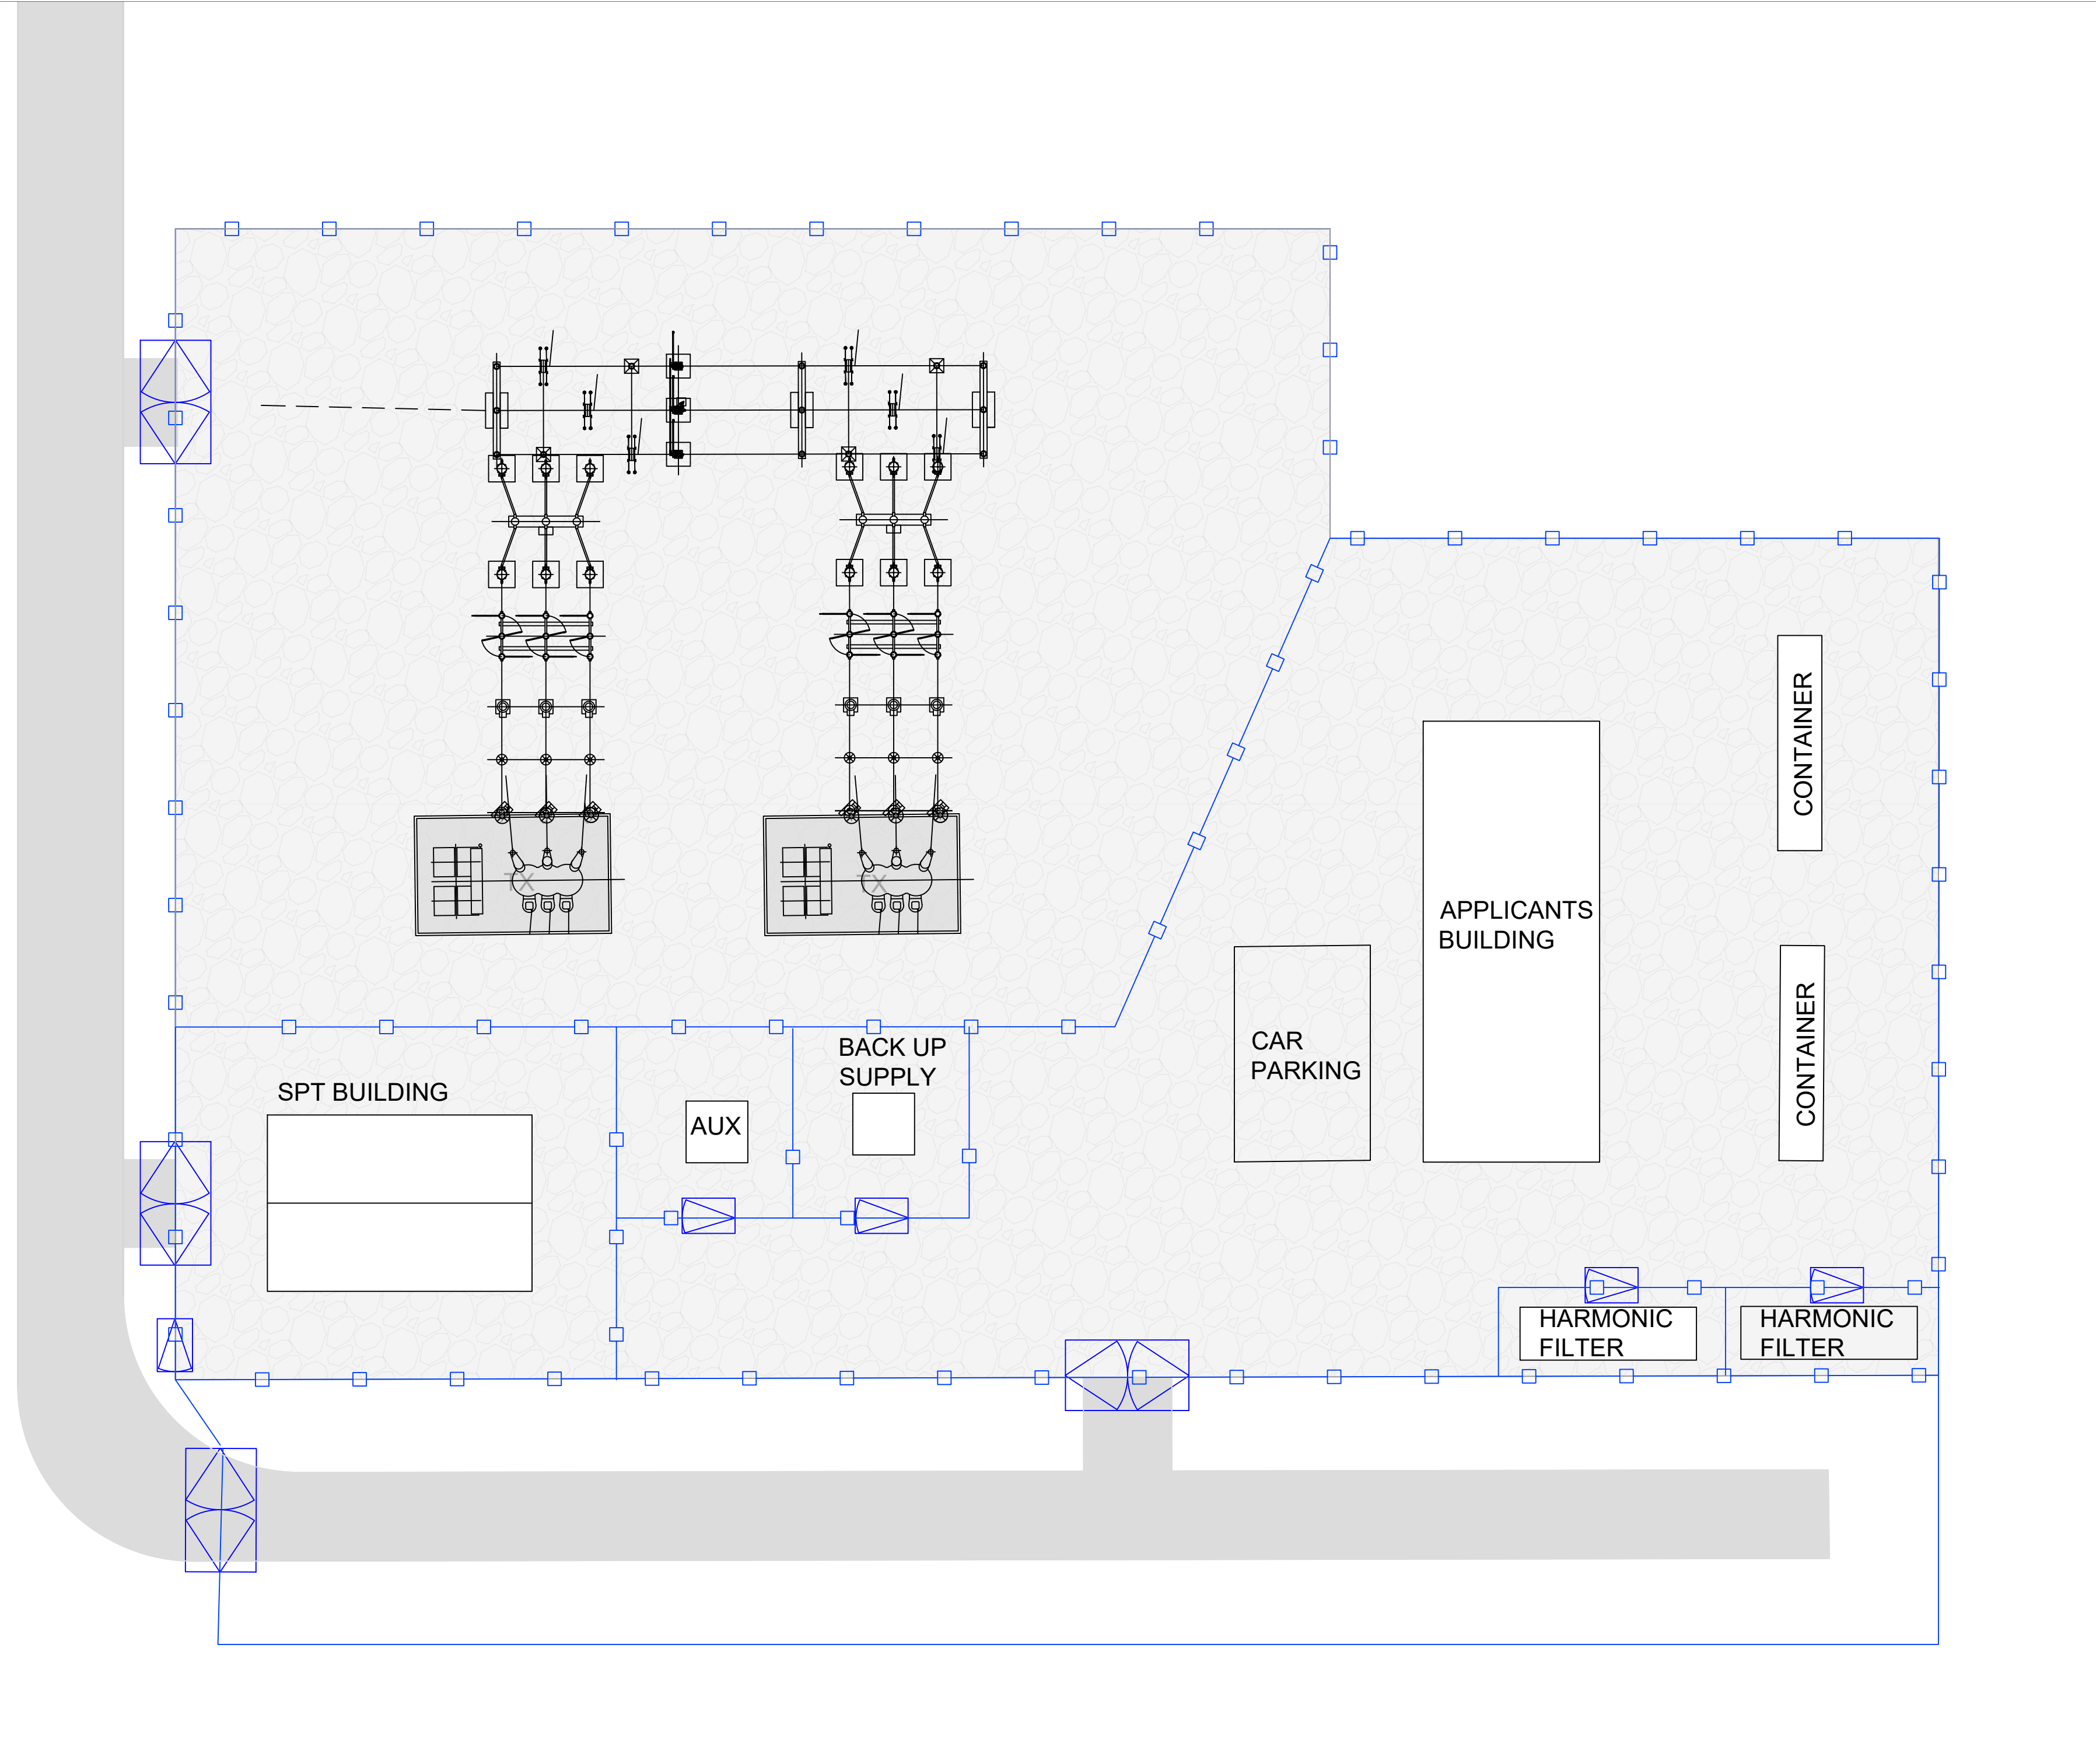

- NOTES
1.

Verifying Dimensions.
The contractor shall verify dimensions against such other drawings or site conditions as pertain to this part of the work.
2.

Existing Services.
Any information concerning the location of existing services indicated on this drawing is intended for general guidance only. It shall be the responsibility of the contractor to determine and verify the exact horizontal and vertical alignment of all cables, pipes, etc. (both underground and overhead) before work commences.
3.

Issue of Drawings.
Hard copies, dwf and pdf will form a controlled issue of the drawing. All other formats (dwg, dxf etc.) are deemed to be an uncontrolled issue and any work carried out based on these files is at the recipients own risk. RPS will not accept any responsibility for any errors arising from the use of these files, either by human error by the recipient, listing of un-dimensioned measurements, compatibility issues with the recipient's software, and any errors arising when these files are used to aid the recipients drawing production, or setting out on site.

Legend

Access track
(Unbound gravel)

Gravel surfacing to Substation Compound

Gated access points to Substation Compound

Secure fencing to Substation Compound

Above Ground Electrical Infrastructure

Rev

Description

Date

Dwn / Chk / App



TETRA TECH

Issuing Office:
Elmwood House, 74 Boucher Road
Belfast,
BT12 6RZ
Tel: +44 (0) 28 9066 7914
tetratech.com/europe

Client



Project Name

Hall Burn Renewable Energy Scheme

Sheet Title

Indicative Substation Layout

Model Reference

-

TTE Project Number

794-NI-P&E-02777

Drawn By

SA 28/05/2026

Checked By

- xx/xx/xxxx

Approved By

- xx/xx/xxxx

Scale @

A2
1:250

Document Reference

02777-TTE-ZZ-XX-DR-LA-0001

Revision

-

Status

Draft

Project Number - Originator - Function - Spatial - Type - Role - Number

© Copyright Tetra Tech Consulting Limited

TTE-A2-V1.1